


**COOLER AND FREEZER NOTES:**

NO CEILING TILE ABOVE WALK-IN FREEZER AND COOLER

CONFIRM CEILING HEIGHT FOR DIRECT MOUNTED COMPRESSORS TO BE A MINIMUM OF 3'-0" ABOVE WALKINS. (CLEAR SPACE).


CONFIRM CEILING HEIGHT FOR REMOTE MOUNTED COMPRESSORS TO BE A MINIMUM OF 6' ABOVE WALKINS. (CLEAR SPACE).

RETURN GRID TO TOP OF BOXES & INSTALL GRID WITH TILES FOR ENCLOSURE PANELS. PROVIDE CLIPS TO HOLD IN PLACE. CAULK BOTTOM EDGE TO FREEZER AT COOLER. INSTALL SUGGESTED MANUFACTURER CLIPS PROVIDE EGG-CRATE GRILLS OR EQUAL FOR ADEQUATE VENTILATION PER MANUFACTURER SUGGESTED SPECIFICATION.



**CEILING AT TRANSITION**


1 1/4" = 1'-0"

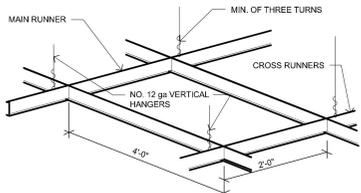

1. METAL SUSPENSION SYSTEM FOR ACOUSTICAL TILE AND LAY-IN PANEL CEILINGS SHALL CONFORM TO THE REQUIREMENTS OF ASTM DESIGN FOR HEAVY DUTY SYSTEMS.
2. INSTALLATION OF METAL CEILING SUSPENSION SYSTEM FOR ACOUSTICAL TILE AND LAY-IN PANELS SHALL CONFORM TO THE REQUIREMENT OF ASTM C636-00.
3. MAIN RUNNERS AT 4'-0" O.C. CROSS RUNNERS AT 2'-0" O.C.
4. VERTICAL HANGERS TO BE MAX. #8 FROM WALLS.


**SUSPENDED CEILING**

2 N.T.S.

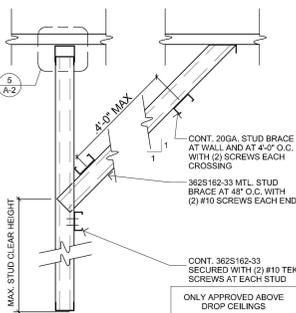

**STUD WALL BRACING**

3 1" = 1'-0"

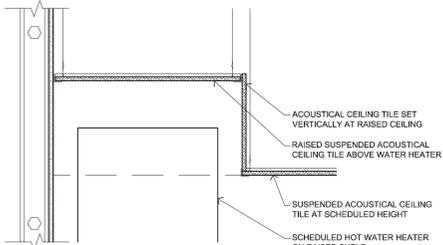


**CEILING ABOVE WATER HEATER**

4 1-1/2" = 1'-0"

**PT-2 (to ceiling tiles, 2'x2')/ pt-2 to walls above ceilings, 3'6"**


**601.9 SQ FT**

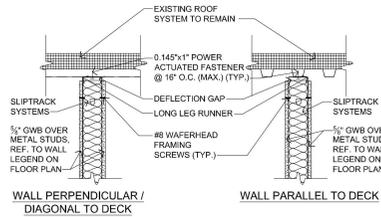

- NOTE:**
1. REF. TO ELEVATIONS FOR WALL FINISHES
  2. G.C. TO VERIFY CONSTRUCTION TYPE PRIOR TO START OF NEW WORK. CONTACT ARCHITECT/ENGINEERS FOR APPROPRIATE CONSTRUCTION IF EXISTING STRUCTURE DIFFERS FROM THAT SHOWN.
  3. REFER TO WALL LEGEND ON FLOOR PLANS FOR INFORMATION ON STUDS AND DRYWALL CONDITIONS.

**SLIP TRACK AT DECK**

5 1" = 1'-0"

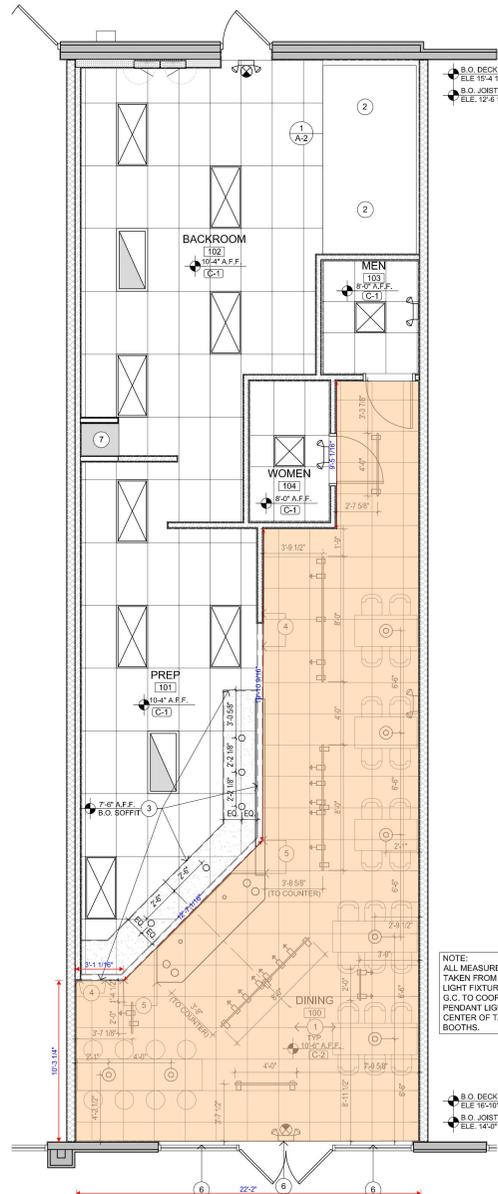

**NOTE:** ALL MEASUREMENT ARE TAKEN FROM CENTERS OF LIGHT FIXTURES. S.C. TO COORDINATE PENDANT LIGHTS WITH CENTER OF TABLES AND BOOTHS.

**CEILING PLAN KEYED NOTES**

1. ACT CEILING - COORDINATE WITH LIGHTING AND MECHANICAL ITEMS. ANY EXPOSED STRUCTURE AND OVERHEAD ITEMS TO BE PAINTED. #1-2.
2. NO CEILING / TILE ABOVE COOLER / FREEZER- OPEN TO DECK.
3. SUSPENDED CEILING GRID ABOVE SOFFIT - SEE 3/A-2.
4. ALIGN FACE OF SOFFIT AND FACE OF FULL HEIGHT PARTITION.
5. SOFFIT WALL FRAMING MUST ALIGN VERTICALLY WITH THE FRAMING OF CASH COUNTER AND KNEEWALL BELOW.
6. ADD HEADER FROM ABOVE STOREFRONT WINDOW IF BOXES AND CONDUITS CAN'T BE RECESSED IN THE EXISTING WALL. ALL JUNCTION BOXES AND CONDUITS MUST BE WITHIN WALL SO A FLUSH AND SMOOTH DRYWALL FINISH CAN BE ACHIEVED. IF HEADER IS REQUIRED THEN FURR WALL ABOVE EVERY STOREFRONT WINDOW WITH 50% O.V.B. ON 3/8" METAL STUDS. BULKHEAD STARTS AT TOP OF WINDOW OPENING.
7. CONTRACTOR TO ADJUST CEILING HEIGHT ABOVE WH IN ORDER TO PROPERLY COORDINATE REQUIRED PIPING CONNECTIONS - SEE 4/A-2.

**SYMBOLS LEGEND**

- (X) KEY NOTES
- ◇ WALL DECORS- SEE SHEET A-6 THRU A-8
- X FINISHES
- X FLOOR FINISHES
- X EQUIPMENT - SEE SHEET A-4
- X DOORS
- X CEILING FINISHES

NOTE: SEE SHEET A-3 FOR ALL FINISHES

**GENERAL NOTES**

1. CONTRACTOR TO PROVIDE CIRCUITS FOR STOREFRONT SIGNS - COORDINATE WITH SIGNAGE SHOP DRAWINGS.
2. ALL LIGHTS IN FOOD PREPARATION AREAS, COOLERS, FREEZERS, STORAGE AND BACK ROOMS ARE TO BE SHELDED.
3. RETURN GRID TO TOP OF BOXES & INSTALL GRID WITH TILES FOR ENCLOSURE PANELS. PROVIDE CLIPS TO HOLD IN PLACE. CAULK BOTTOM EDGE TO FREEZER AND COOLER. INSTALL SUGGESTED MANUFACTURER CLIPS. PROVIDE EGG-CRATE GRILLS OR EQUAL FOR ADEQUATE VENTILATION PER MANUFACTURER SUGGESTED SPECIFICATION.
4. SEE SHEET A-1 FOR WALL LEGEND AND INFORMATION.
5. DIMENSIONS ARE FROM INTERIOR FACE OF EXISTING FINISHES AT EXISTING WALLS AND FACE OF FINISH MATERIAL AT NEW STUD WALLS.
6. REFERENCE SHEET E-2 FOR REQUIRED LIGHTING FIXTURE SPECS & HEIGHTS.
7. CEILING GRID MUST ATTACH TO WALL TILE AT SPECIFIED HEIGHT PER A-2.
8. SCRM CEILING (S/W) EXPOSED INSULATION IS NOT APPROVED

**BAYUS DESIGN**  
WORKS OF ARCHITECTURE  
1981 Commonwealth Court, Suite A • Louisville, KY 40299  
6.502.426.8000 • T. 502.426.0227 • bayus@bayusdesign.com

STATE OF SOUTH CAROLINA  
ANTHONY J. BAYUS  
Louisville, KY No. 8400  
REGISTERED ARCHITECT  
EXP. DATE: 6/30/18

**JIMMY JOHN'S**  
Since **JJ** 1983  
SANDWICHES

DATE	
DELTA	

**JIMMY JOHN'S**  
STORE #3958 - FACTORY DESIGN  
HIGHWAY 17 BYPASS & LOYOLA DRIVE  
MYRTLE BEACH, SC 29588

SHEET TITLE  
**REFLECTED CEILING PLAN AND DETAILS**  
JOB NO  
**18-892-693**  
DATE 11-14-18  
CHECKED SM  
SHEET NO  
**A-2**


**REFLECTED CEILING PLAN**  
A 1/4" = 1'-0" NORTH






- NOTES:**
- DINING ROOM AND KITCHEN WALL TILE TO BE BUTTED TIGHT, THEN GROUTED.
  - REFER TO SHEET A-3 FOR INTERIOR FINISH SCHEDULE. DRYWALL, WALL FINISHES TO EXTEND TO DECK/CILING.
  - ALL OUTSIDE CORNERS OF WALL TILE IN CUSTOMER AREA MUST RECEIVE BULLNOSE AND BASE MUST BE A BULLNOSE TILE W/ 45° MITER.
  - MUST FURR OUT AROUND BEAMS AT WALLS TO CREATE A BULKHEAD. DRYWALL MUST EXTEND TO DECK/CEILING.
  - STRUCTURAL MEMBERS INTERSECTING DINING WALLS THAT DO NOT ALLOW DRYWALL FINISHES TO EXTEND TO DECK MUST BE FURRED OUT TO ALLOW CONTINUATION OF DRYWALL FINISHES TO EXTEND TO DECK/CEILING.
  - FULL SHEETS OF FRP ARE TO BE INSTALLED RESULTING IN ONLY VERTICAL SEAMS. HORIZONTAL BREAKS IN FRP ARE NOT APPROVED.
- NOTE ON GROUT COLOR:  
 WT-2 GROUT FOR ALL WHITE, RED & BLACK WALL TILE (TYP. FOR WT-1, WT-2, & WT-3)

\*\* ALL INTERIOR SIGNAGE SHOWN ON ELEVATIONS AND ENTIRE SINTRA SIGN PACKAGE TO BE PROVIDED BY OWNER AND INSTALLED BY G.C.

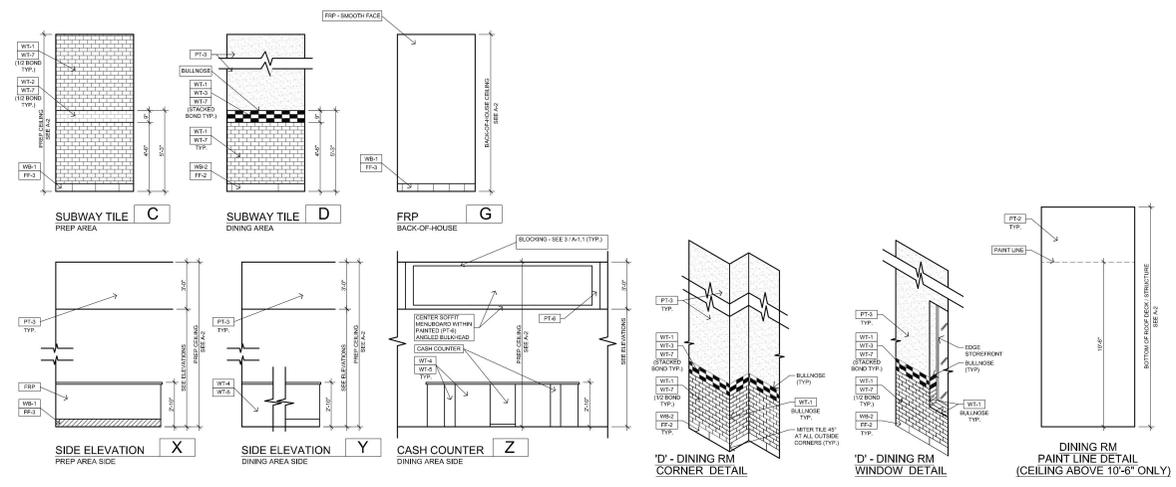

**PT-3** 104.9 SQ FT

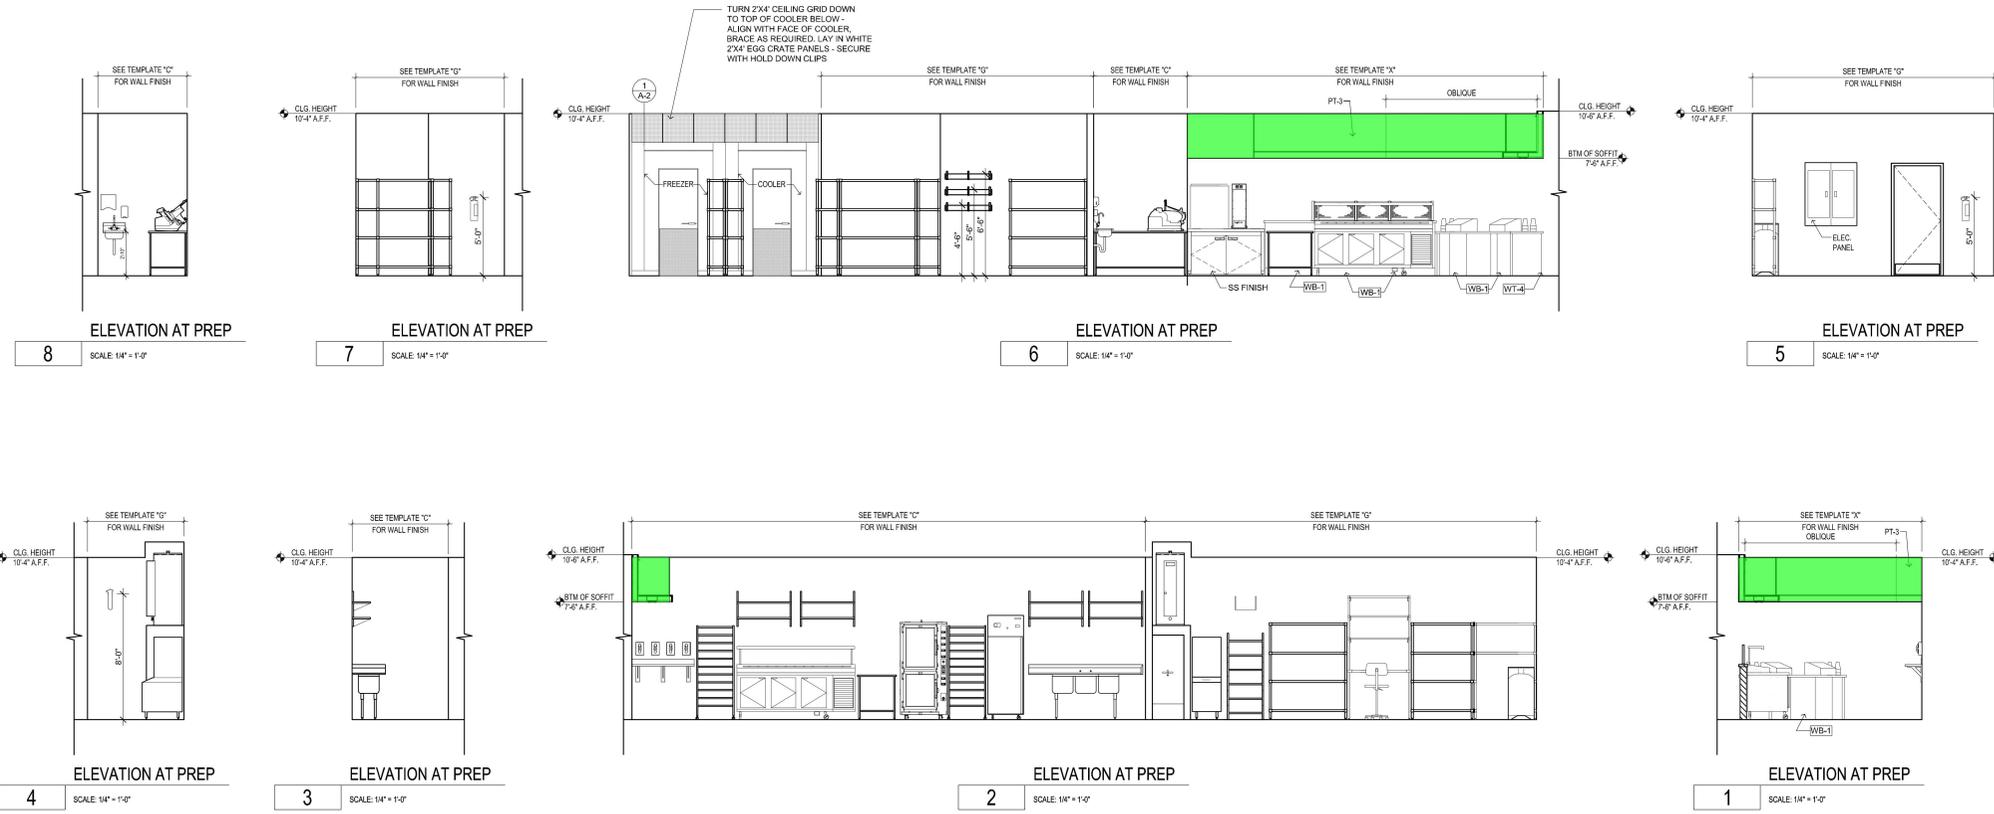

DATE	
DELTA	